

PER GVA, WITH CONCURRENCE FROM DFL,
USE 1/2" (12 mm) JOINT WIDTH.


ETF
7/22/96

CIRCULATE - OUR TEAM

ETF Lii
C.F. JHP
JWD
MCC

NOTE: UPDATE CADD CELLS &
STANDARD NOTES.


JAC

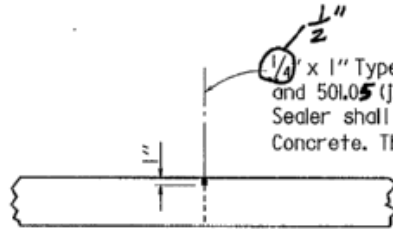

1/2" x 1" Type 6 Joint Sealer. See Sections 501.02 (h) and 501.05 (j) of the Standard Specifications. Joint Sealer shall be measured and paid for as Class S(AE) Concrete. This joint shall be formed.

LONGITUDINAL CONSTRUCTION JOINT

NTS

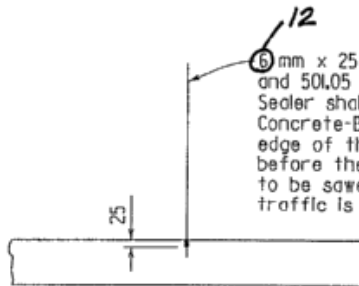

12 mm x 25 mm Type 6 Joint Sealer. See Sections 501.02 (h) and 501.05 (j) of the Standard Specifications. Joint Sealer shall be measured and paid for as Class S(AE) Concrete-Bridge. Slab joints shall extend to the outside edge of the deck slab. Slab joints shall be installed before the parapet railing is poured. If slab joints are to be sawed, they shall be sawed before any vehicular traffic is allowed on the unit.

SLAB JOINT DETAIL

No Scale